


Measurements in mm

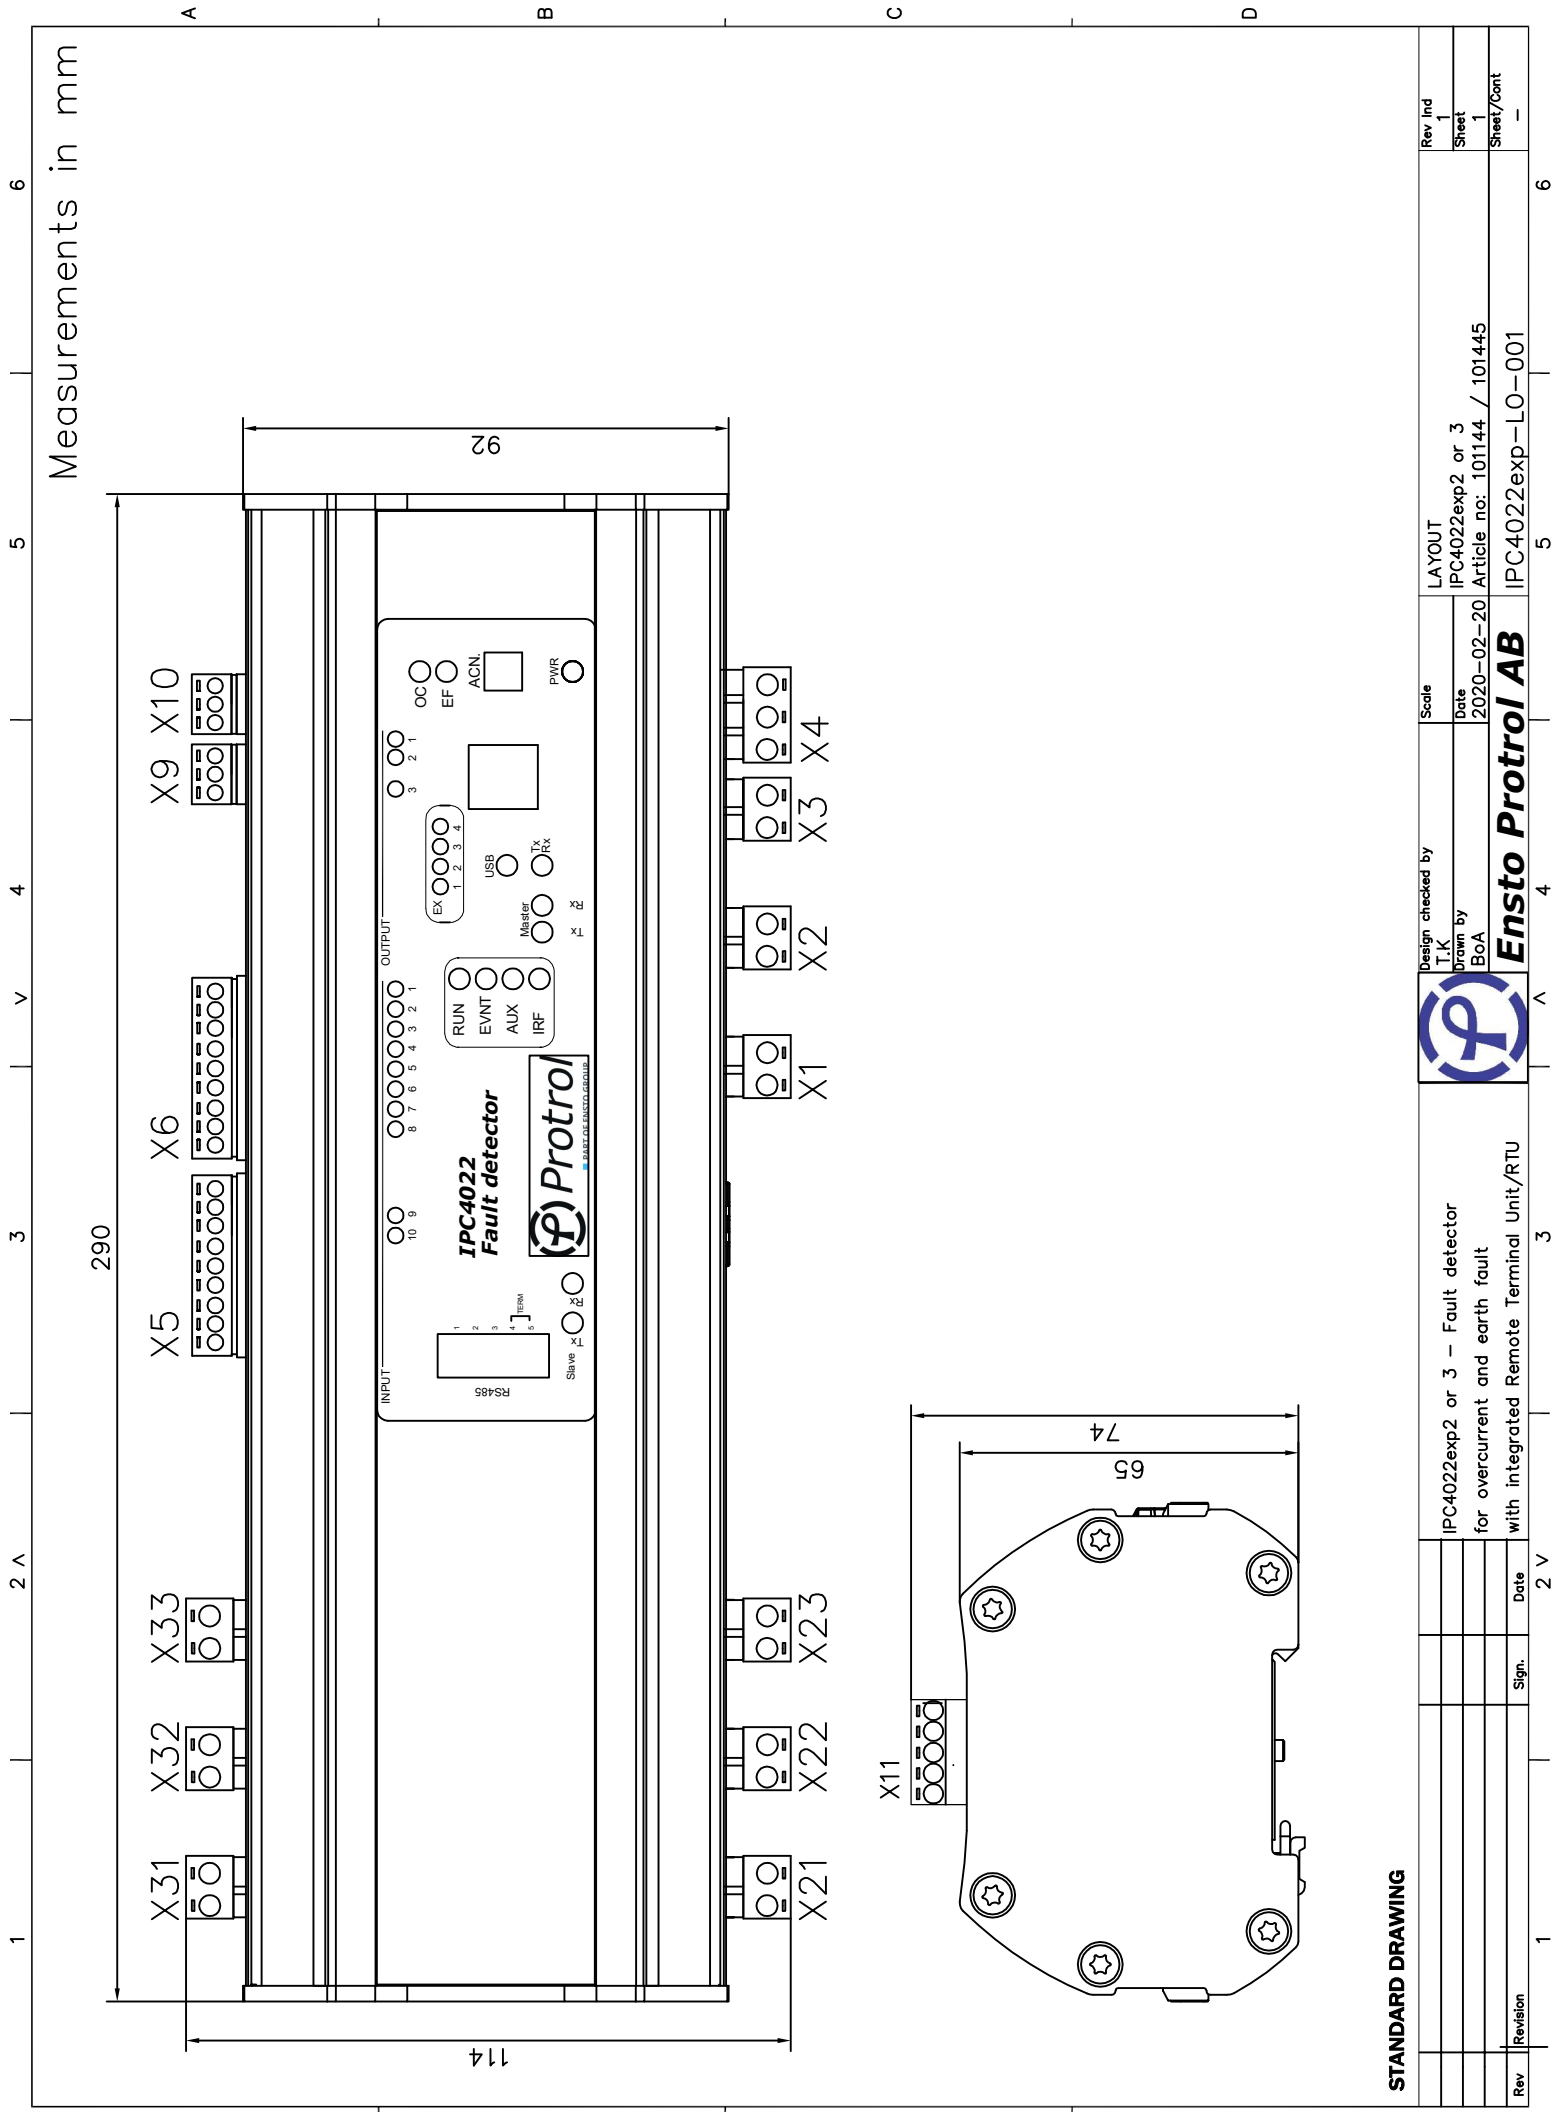

We reserve all rights in this document and the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden.

IPC4022exp-LO-001\_0001.dwg

**STANDARD DRAWING**

Rev	Revision	Date	Sign.	with integrated Remote Terminal Unit/RTU		Scale	Design checked by	LAYOUT	Rev Ind
				IPC4022exp2 or 3 - Fault detector for overcurrent and earth fault		T.K	T.K	IPC4022exp2 or 3	1
				for overcurrent and earth fault		BoA	BoA	Article no: 101144 / 101445	Sheet
				Date					1
				2020-02-20					Sheet/Cont
				2					-
				3					
				4					
				5					
				6					
				7					
				8					
				9					
				10					
				11					
				12					
				13					
				14					
				15					
				16					
				17					
				18					
				19					
				20					

**Ensto Protrol AB**

